



REMOTE PUSHBUTTON WIRING

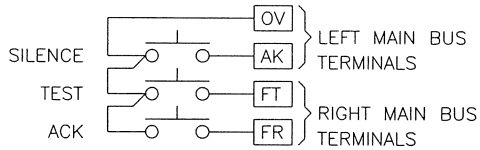

INTEGRAL PUSHBUTTON MODEL NO. 90PB36*

NT2-24D AUDIBLE DEVICE WIRING

DIAGRAM SHOWS NOVATONE HORN WITH P1 TERMINAL BLOCK ON P.C. BOARD ATTACHED TO HORN (REF. DWG. 57100-48) FOR EARLIER VERSIONS WITH PIGTAIL LEADS, CONNECT BLACK TO OV, RED TO +24 AND BLUE TO FLASHER TERMINAL (REF. DWG. 57100-44).

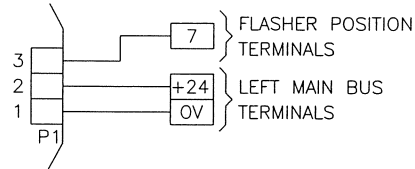

OPERATIONAL SEQUENCE "ASFR"


| INPUT STATUS | FIRST VISUAL | SUBSEQUENT VISUAL | AUDIBLE |
|------------------|--------------|-------------------|---------|
| FIRST ALARM | FAST FLASH | ----- | ON |
| SUBSEQUENT ALARM | ----- | STEADY-ON | ON |
| SILENCE | FAST FLASH | STEADY-ON | OFF |
| ACK | STEADY-ON | STEADY-ON | OFF |
| RETURN TO NORMAL | OFF | OFF | OFF |
| TEST | FAST FLASH | ----- | ON |

NOTES:


- IF A NEW ALARM OCCURS WHILE TESTING, POINT WILL INDICATE ALARM CONDITION (RE-ALARM) AFTER ACKNOWLEDGE PUSHBUTTON IS OPERATED.
- POINT WILL INDICATE ALARM WHEN TEST PUSHBUTTON IS OPERATED IF THE VISUAL INDICATOR IS OFF OR STEADY-ON.

COMMON AUXILIARY RELAY WIRING

FOR CUSTOMER USE IF REQUIRED




MODEL 90AX1 (DE-ENERGIZED IN NORMAL) OR 90AX2 (ENERGIZED IN NORMAL) WITH WB-3 WIRING BOX

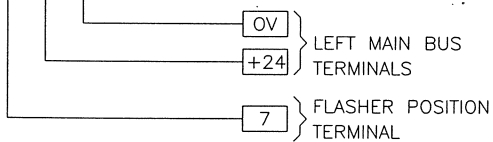

RELAY CONTACTS RATED 4 AMPS AT 250VAC OR 5 AMPS AT 28VDC OR 120VAC AND 0.5 AMP AT 125VDC RESISTIVE LOAD.

TERMINAL GROUPING DIAGRAM

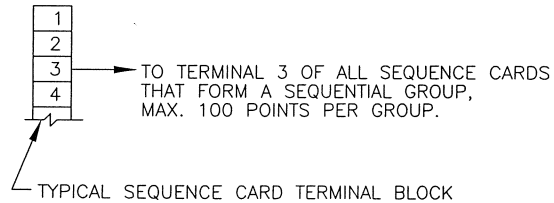

ALARM PLUG-IN CARD MODEL NO. _____

9* AS 2

SINGLE POINT = 91
 TWIN POINT = 92

SEQUENCE CODE _____

VARIATION _____

INPUT OPTIONS DWG. LIST, REFER TO _____
 91900-1 & 92900-1

OUTPUT OPTIONS DWG. LIST, REFER TO _____
 91900-2 & 92900-2

| REV | ECN NO. | BY | APPD | DATE | MATERIAL: |
|-----|---------|----|------------|----------|--------------------|
| 00 | 7100-82 | SK | AHD | 02/27/90 | FINISH: |
| 01 | 11872 | SK | <i>Jan</i> | 6/15/01 | USED ON/REF. DWG |
| | | | | | DESCRIPTION |
| | | | | | 91AS* DRAWING LIST |
| | | | | | 92AS* DRAWING LIST |

TOL. UNLESS SPECIFIED

INCHES
 .X = .015
 .XX = .010
 .XXX = .005

MILLIMETERS
 X.0 = 1.0
 0.X = 0.4
 0.XX = 0.1

ANGLES ±0°30'

SCALE INCH (MM)
 NTS




PANALARM 1725 WESTERN DRIVE, WEST CHICAGO, IL., 60185, U.S.A.
 PHONE: 1-630-231-5900 FAX: 1-630-231-4502

DWN. BY S. KUNCA

APPD/DATE AHD 02/27/90

THIRD ANGLE PROJECTION



CUSTOMER WIRING DIAGRAM AND SEQUENCE 'ASFR' INFORMATION FOR SERIES 90

SHEET 1 OF 1

DWG. NO. 90450-AS2-1

-B-

