
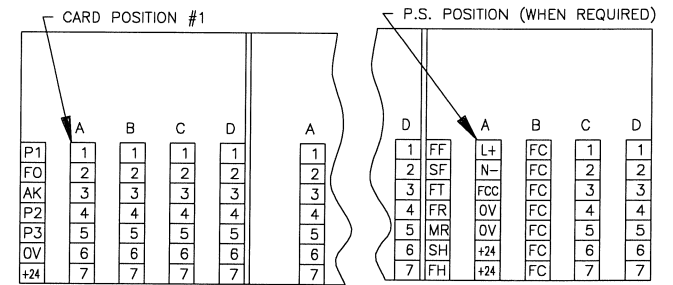


NOTES:

- 1 NORMAL FLASHER LOCATION: LOWER RIGHT MODULE (FRONT VIEW). IN SYSTEMS WITH INTEGRAL P.S.U., NORMAL FLASHER LOCATION IS IN SLOT (D) OF ADJACENT MODULE. FLASHER CAPACITY: 300 POINTS.
- 2 "USER" MAIN BUS BLOCKS PROVIDED ON ALL EXCEPT REMOTE LOGIC CHASSIS, ONE ROW HIGH CABINETS AND 94CA22 CABINETS. REFER TO DRAWING 90900-21.
3. TOTAL CURRENT FOR COMBINED REMOTE AND INTEGRAL LAMPS NOT TO EXCEED 320mA PER POINT AT 24VDC.
4. USE NUMBER 85 LAMP (PANALARM P/N 430039) IN LAMP BOX. NOMINAL CURRENT IS 40mA AT 24V.
5. DASHED LINES INDICATE CUSTOMER FIELD WIRING.

REMOTE POWER SUPPLY UNIT WIRING SHOWN (OR) INTEGRAL POWER SUPPLY UNIT WIRING SHOWN

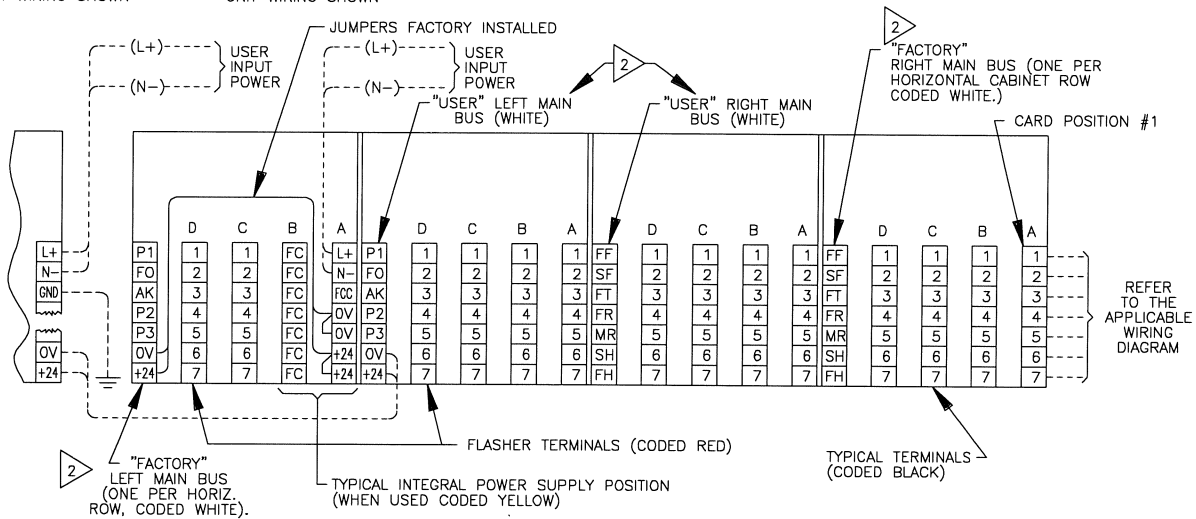

TYPICAL VIEW OF FRONT ACCESS TERMINAL ARRANGEMENT

TYPICAL VIEW OF REAR TERMINAL ARRANGEMENT


REV	ECN NO.	BY	APPD	DATE	MATERIAL:	TOL. UNLESS SPECIFIED	 PANALARM 1725 WESTERN DRIVE, WEST CHICAGO, IL., 60185, U.S.A. PHONE: 1-630-231-5900 FAX: 1-630-231-4502		
00	7097-53	SK	AHD	02/04/93	FINISH:	INCHES .X = .015 .XX = .010 .XXX = .005			
01	11872	SK	.	/ /	USED ON/REF. DWG	MILLIMETERS X.O = 1.0 O.X = 0.4 O.XX = 0.1	DWN. BY S. KUNCA APPD/DATE AHD 08/04/93 THIRD ANGLE PROJECTION 		
					DESCRIPTION	ANGLES ±0°30'			
					93450-MP1-1	SCALE INCH (MM)	SHEET 1 OF 1 DWG. NO. 94400-30-1 -B-		
						NONE (MM)			



94400-30-1-01-01.dwg

© 1993

NONE (MM)



SHEET 1 OF 1

DWG. NO. 94400-30-1

-B-