
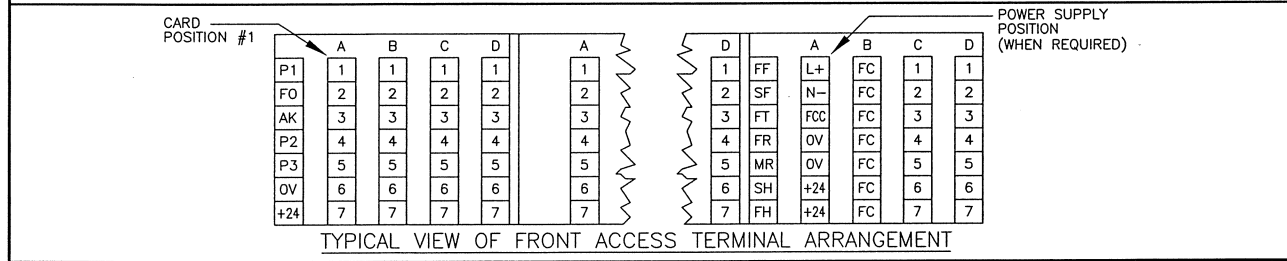
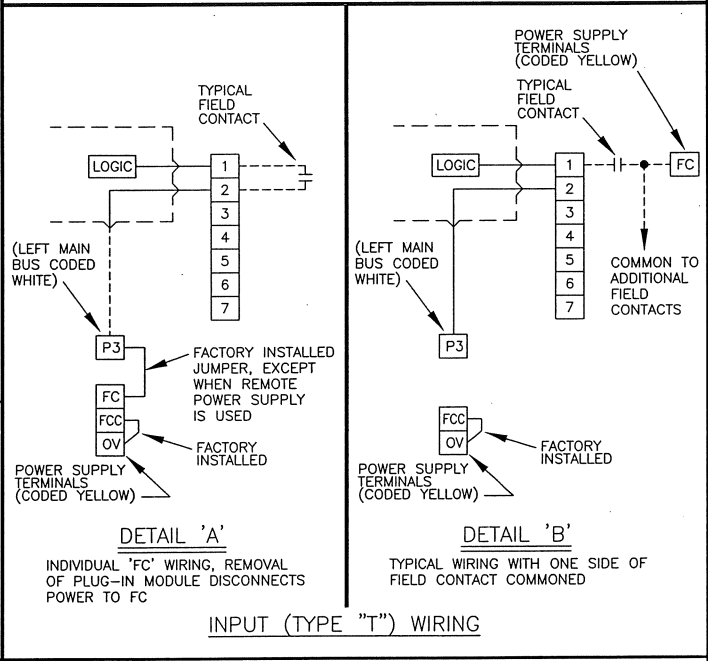


- NOTES:
- 1. NORMAL FLASHER LOCATION: LOWER RIGHT MODULE (FRONT VIEW). IN SYSTEMS WITH INTEGRAL POWER SUPPLY UNIT, NORMAL FLASHER LOCATION IS IN SLOT (D) OF ADJACENT MODULE. FLASHER CAPACITY: 300 POINTS.
 - 2. "USER" MAIN BUS BLOCKS PROVIDED ON ALL EXCEPT REMOTE LOGIC CHASSIS, ONE ROW HIGH CABINETS AND 94CA22 CABINETS. REFER TO DRAWING 90900-21.
 - 3. TOTAL CURRENT FOR COMBINED REMOTE AND INTEGRAL LAMPS NOT TO EXCEED 320mA PER POINT AT 24VDC. REMOTE LAMP OUTPUT IS NOT AVAILABLE WHEN TERMINAL "7" IS USED FOR ANOTHER FUNCTION.
 - 4. TYPICAL CARD WITH SWITCH FOR N.O./N.C. SW1 POSITION
N.O. = SWITCH OPEN
N.C. = SWITCH CLOSED
 - 5. USE NUMBER 85 LAMP (PANALARM P/N 430039) IN LAMP BOX. NOMINAL CURRENT IS 40mA. AT 24V.
 - 6. DASHED LINES INDICATE CUSTOMER FIELD WIRING.

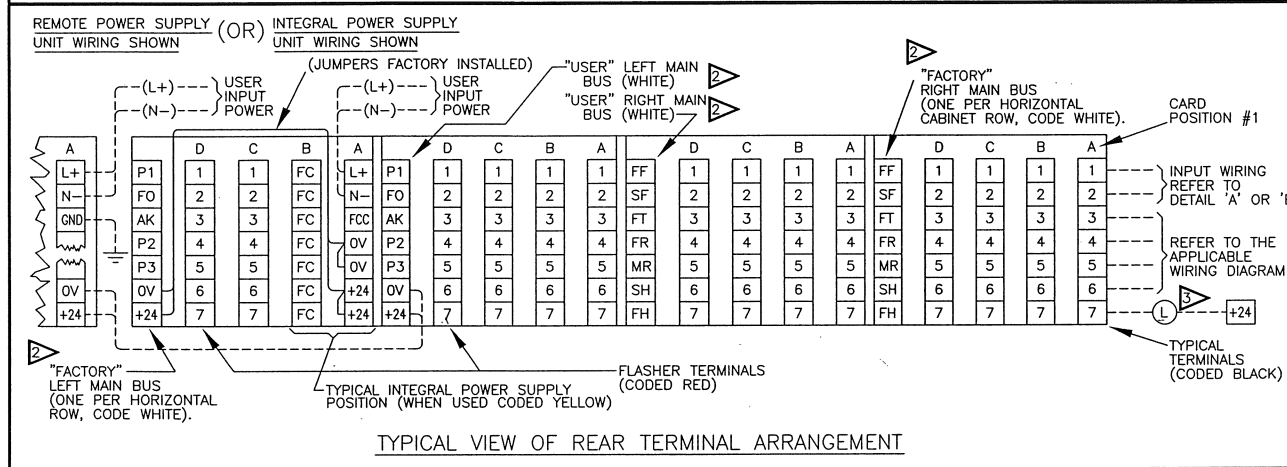

REV	ECN NO.	BY	APPD	DATE	MATERIAL:	
06	9300-41	MR	RCV	09/04/86	FINISH:	
07	9550	LJ	PG	06/04/87	USED ON/REF. DWG	DESCRIPTION
08	11872	SK	MAJ	6/15/01		

TOL. UNLESS SPECIFIED

INCHES
.X = .015
.XX = .010
.XXX = .005

MILLIMETERS
X.0 = 1.0
0.X = 0.4
0.XX = 0.1

ANGLES ±0°30'

SCALE INCH NONE (MM)

AMETEK

PANALARM 1725 WESTERN DRIVE, WEST CHICAGO, IL., 60185, U.S.A.
PHONE: 1-630-231-5900 FAX: 1-630-231-4502

DWN. BY LJ / SK
APPD/DATE AFR 02/18/81
THIRD ANGLE PROJECTION

TERMINAL ARRANGEMENT OF 94 STYLE MODULE
(4 TERMINAL BLOCKS PER MODULE) (WITH 91LA LAMP BOX)
WITH (1) 91* CARD (1 POINT PER CARD) USING TYPE "T" INPUTS

SHEET 1 OF 1 DWG. NO. 94400-11-1 -B-